RoHS COMPLIANT

CUSTOMER:	P/N: 0310.120RET	REV.	APPROVED BY:

REVISIONS		
REV.	DESCRIPTION	DATE
A		
B		
C		
D		
E		

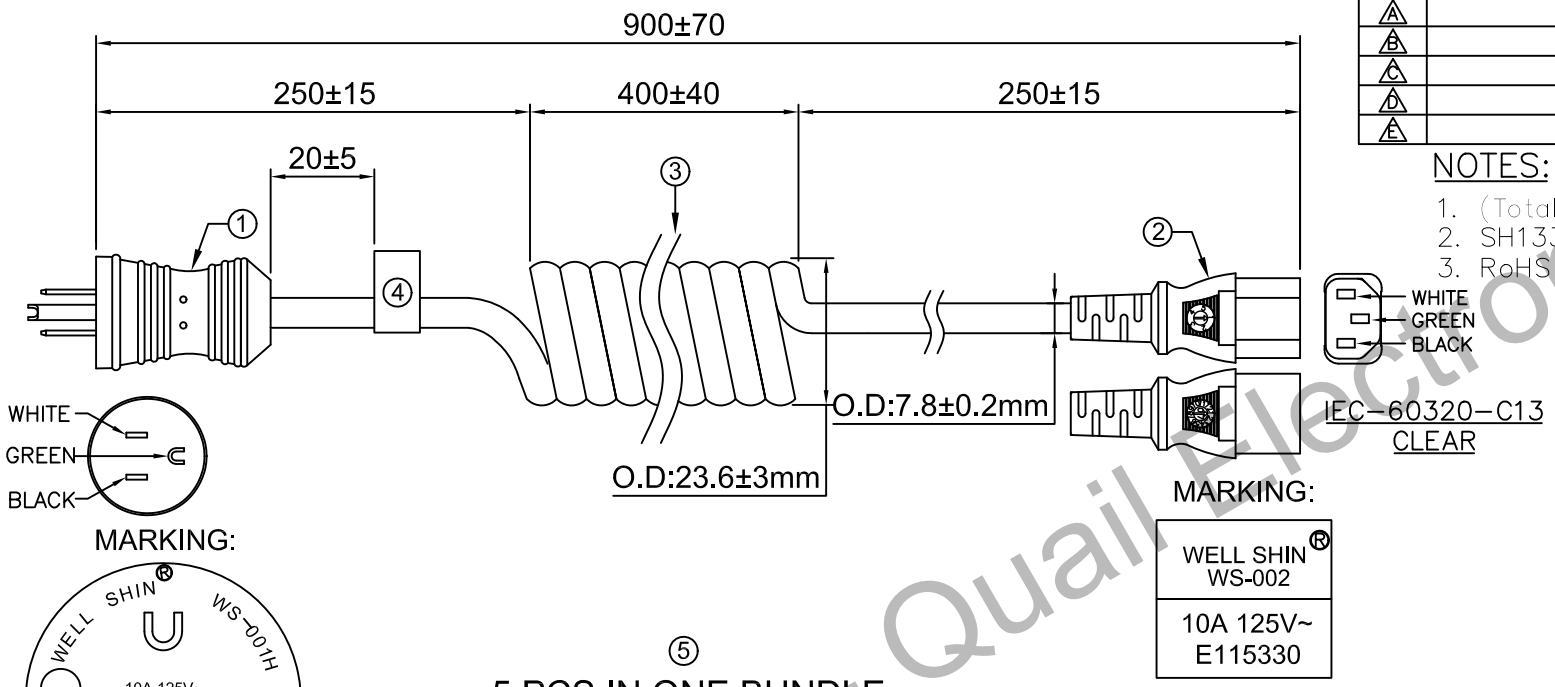

NOTES:

1. (TotalLength): 3045mm (Estimate)
2. SH1330064
3. RoHS

MARKING:

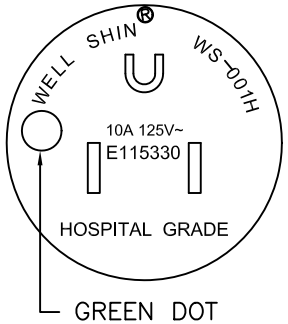

NEMA 5-15P
HOSPITAL GRADE CLEAR

⑤ 5 PCS IN ONE BUNDLE

④ HOSP. GRADE LABEL

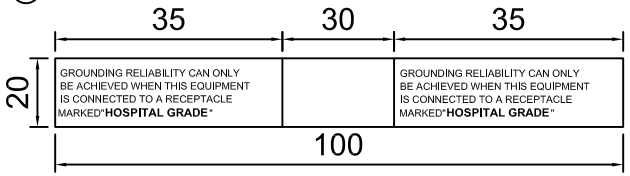

ITEM	DESCRIPTION	COLOR	QTY
5	CABLE TIE	WHITE	2
4	HOSP. GRADE LABEL	---	1
3	SJTW 18AWG 3C 105¢XC APPROVAL: UL,CSA	(GY-H) PANTONE Cool Gray 9C	1
2	WS-002 10(A) 125(V) APPROVAL: UL,CUL	CLEAR	1
1	WS-001H(5-15P) 10(A) 125(V) APPROVAL: UL,CUL		1

MARKING: Ⓜ FOR DONG-GUAN PLANT, Ⓚ FOR KUN-SHAN PLANT

	SIGNATURE
ENGINEER:	
MANAGER:	
CHECKED BY:	
DRAWN BY:	

QUAIL ELECTRONICS, INC.®
http://www.quail.com

PRODUCT NO.: 001H-1+002-1 DATE: 2013/04/09
UNIT: mm SHEET: 1 OF 1 REV.
DWG NO: 0096-4355

THE INFORMATION CONTAINED HEREIN IS PROPRIETARY TO QUAIL ELECTRONICS, INC. ANY USE OR DISCLOSURE OF THIS INFORMATION, EXCEPT FOR THE EXCLUSIVE BENEFIT OF QUAIL ELECTRONICS, INC.® IS PROHIBITED.

Copyright 2013 Quail Electronics, Inc.